


BELOW-GROUND BULK TANK OPTIONS

A below-ground tank provides you with a discreet solution – the whole tank is buried below ground leaving only the access cover visible. Ideal if you are short on outdoor space.


Below is the range of underground tanks CamGas can offer along with our recommendation for your requirements.

For more information please contact Head Office on 01244 520551

or email: enquiries@camgas.co.uk.

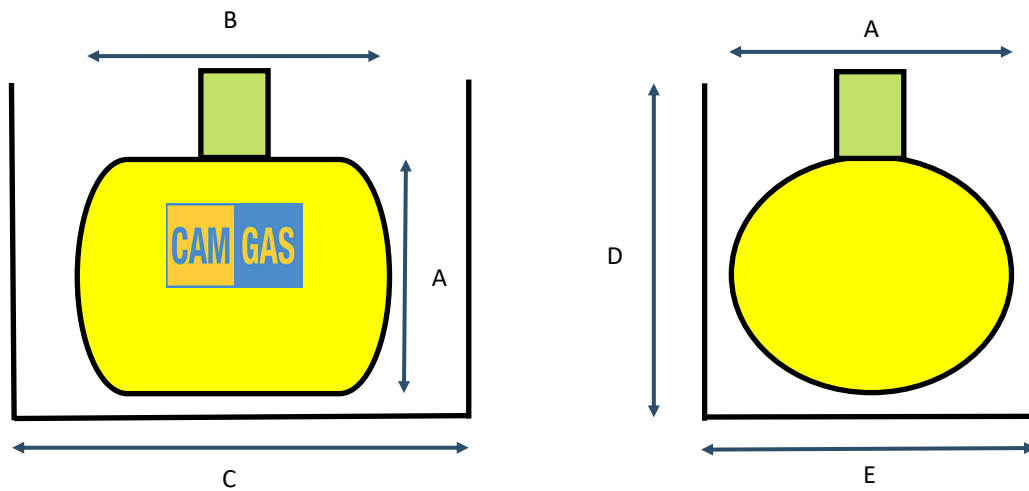

Tank Size (L)	1410	2200	3965	4603
Application	The smallest of our tanks is suitable for low consumption domestic houses. Typically houses with less then five bedrooms.	This tank is suitable for larger consumption domestic property's. Typically property's with five or more bedrooms.	Normally this size tank would be used for supplying multiple property's or medium sized commercial buildings.	The largest of our underground tanks can be used for large metered estates and large scale commercial property's and process's.
Propane Capacity (KG)	600	1000	1750	2000
Tank Diameter (A) (M)	1	1	1.2	1.2
Tank Length (B) (M)	2.12	3.05	3.8	4.4
Excavation Length (C) (M)	3.0	4.0	4.9	5.6
Excavation Depth (D) (M)	1.57	1.57	1.87	1.87
Excavation Width (E) (M)	2.0	2.0	2.2	2.2
Recommended for your requirements				

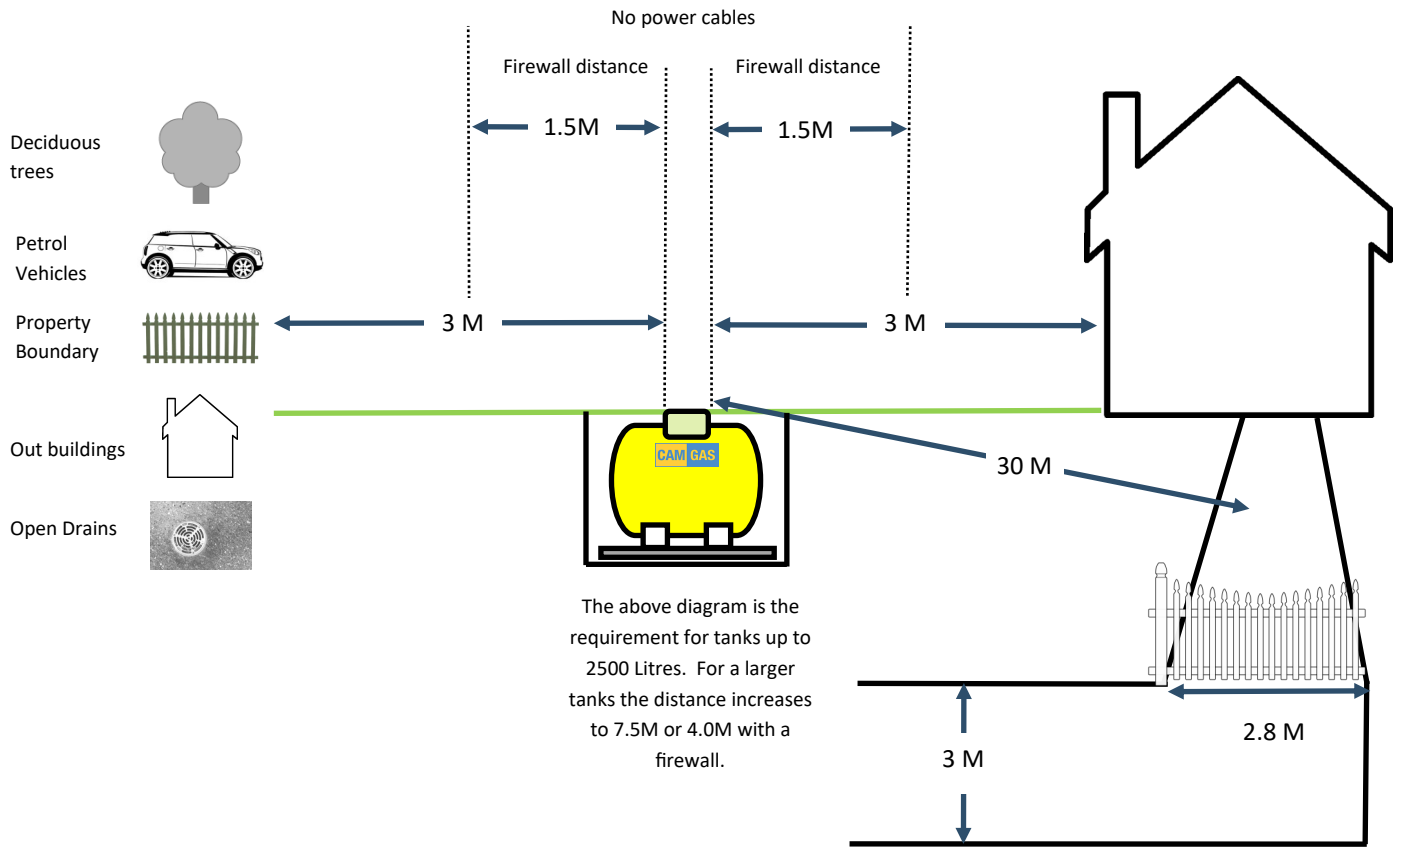

BELOW GROUND TANK SITING REQUIRMENTS

The above will help ensure your tank is sited correctly. To do this the required safety distance between property, boundary and sources of ignition must be met as in the above diagram. **Please note the tank hood from which measurements are made is 1 meter in diameter.**


Should you be unsure or require any guidance please contact Head Office on 01244 520551

or email: enquiries@camgas.co.uk.

FIREWALLS

Firewalls can be used to reduce the separation distance. They should have no openings and be constructed of brick, concrete or solid masonry. Some boundary walls can be classed as a firewall if they meet the requirements of fabrication and are im-perforate.

The height and distance should exceed the 3M requirement on all angles. There can be a maximum of two firewalls and they can not be connected.

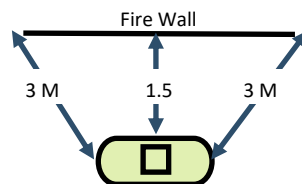

DELIVERY VEHICLE ACCESS

The tanker delivery requires the vessel to be with in 30 meters from the point of filling, while filling the driver must have line of sight between the tanker and vessel.